

Marsden Research Labs
1-844-8-MRLABS
info@mrlabs.us
465 Nevada Way Suite 3
Boulder City, NV 89005



Project 145982
Lab # 215275
Date Rec'd 10/5/2026
Report Issued 10/27/2026

Certificate of Analysis



Compound NAD+
Label Claim 1000 mg
Batch/Lot MRL-NJ1000


<u>Analyte</u>	<u>Result</u>	<u>Units</u>	<u>LOQ</u>	<u>% of Label</u>	<u>Method</u>	<u>Date</u>	<u>CAS</u>
Peptides & Bioactives							
Chromatographic purity	98.4	%	1		HPLC-UV/MS	10/15/2026	
NAD+	821	mg	.1	82.1	HPLC-UV-MS	10/15/2026	53-84-9
Mass Spectral Match	ID Confirmed				HPLC-UV-MS	10/15/2026	

The data presented are from the analysis of the sample shown and meet Krause Analytical internal quality assurance criteria unless otherwise flagged.
Methods shown reference current Krause Analytical SOPs
ND - Not detected LOQ - limit of quantification
All values reported on a per vial basis unless otherwise noted
Copyright © 2026 Krause Analytical LLC. All rights reserved.


Respectfully submitted,

Mark C. Krause
Laboratory Director

CHROMATOGRAM

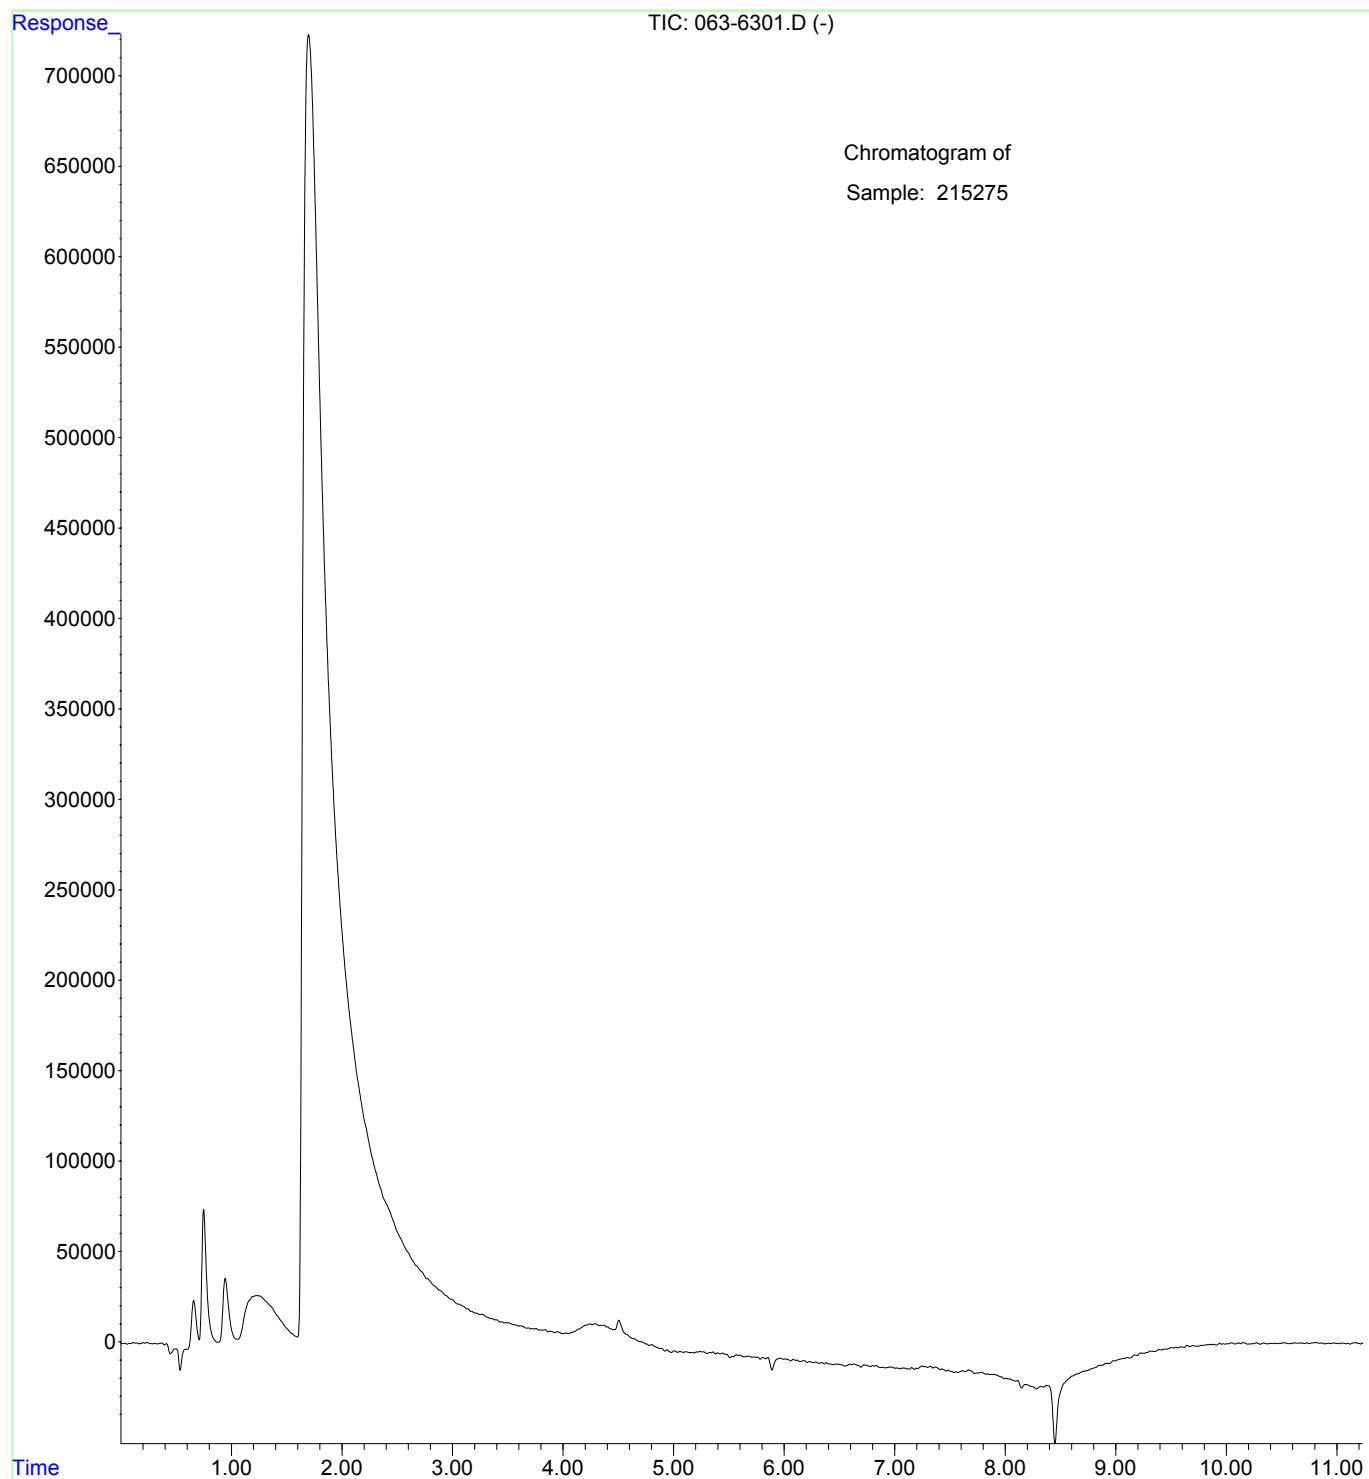

215275 21 (0.388)

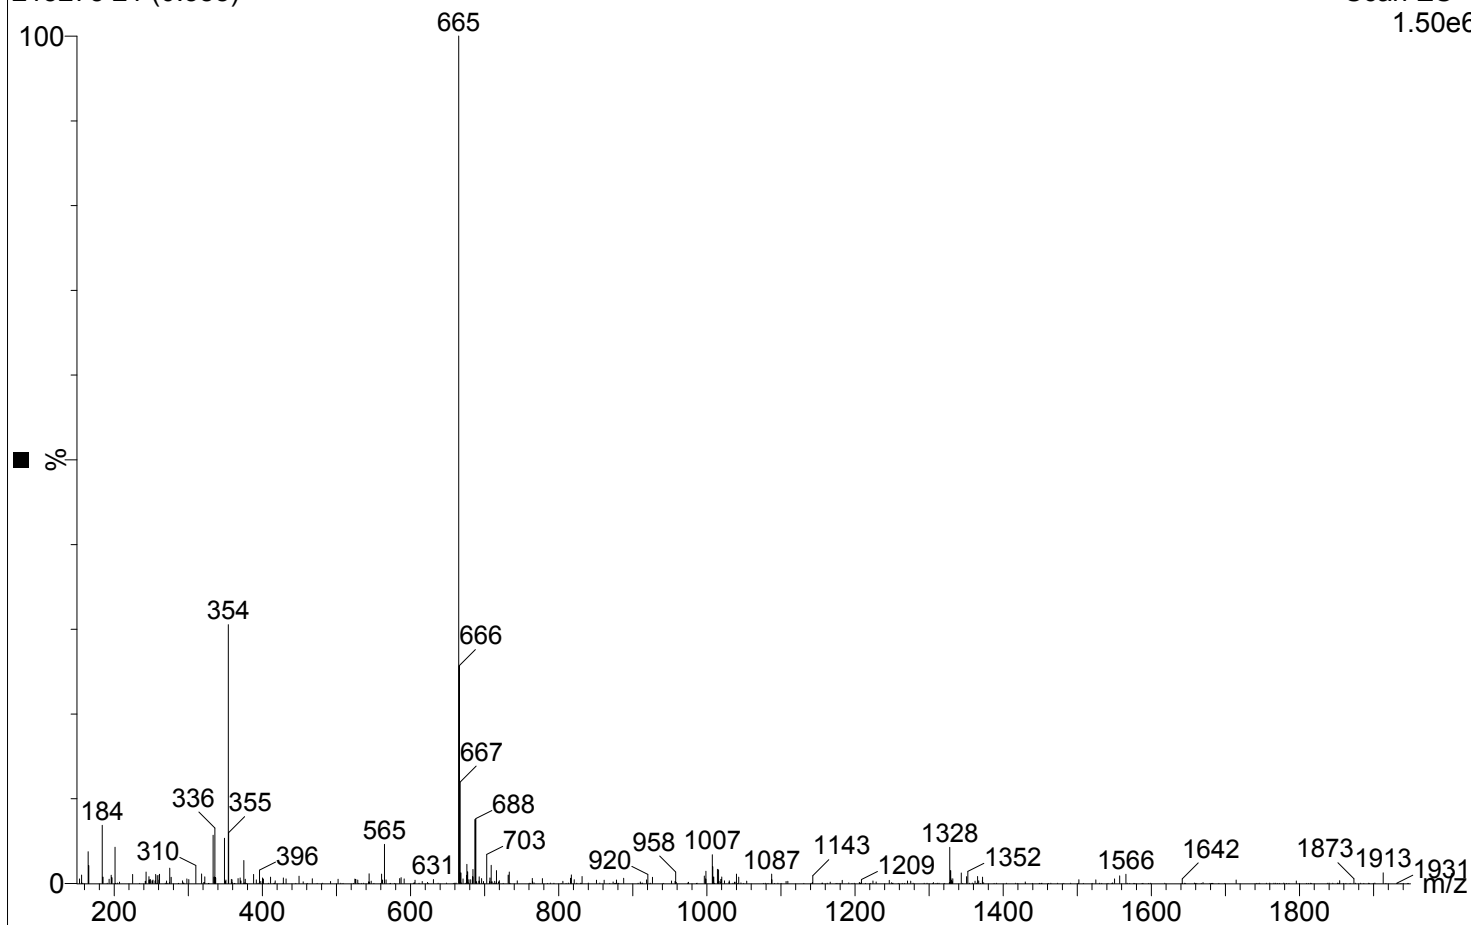Scan ES+
1.50e6

NAD+ 21 (0.388)

Scan ES+
1.50e6