

Marsden Research Labs  
 1-844-8-MRLABS  
 info@mrlabs.us  
 465 Nevada Way Suite 3  
 Boulder City, NV 89005



**Project** 145982  
**Lab #** 215284  
**Date Rec'd** 10/5/2026  
**Report Issued** 10/27/2026

## Certificate of Analysis



**Compound** Retatrutide  
**Label Claim** 40 mg  
**Batch/Lot** MRL-RT40


| <u>Analyte</u>                   | <u>Result</u> | <u>Units</u> | <u>LOQ</u> | <u>% of Label</u> | <u>Method</u> | <u>Date</u> | <u>CAS</u>   |
|----------------------------------|---------------|--------------|------------|-------------------|---------------|-------------|--------------|
| <b>Peptides &amp; Bioactives</b> |               |              |            |                   |               |             |              |
| Chromatographic purity           | 99.7          | %            | 1          |                   | HPLC-UV/MS    | 10/10/2026  |              |
| Retatrutide                      | 32.7          | mg           | .1         | 81.7              | HPLC-UV-MS    | 10/10/2026  | 2381089-83-2 |
| Mass Spectral Match              | ID Confirmed  |              |            |                   | HPLC-UV-MS    | 10/10/2026  |              |

The data presented are from the analysis of the sample shown and meet Krause Analytical internal quality assurance criteria unless otherwise flagged.  
 Methods shown reference current Krause Analytical SOPs  
 ND - Not detected LOQ - limit of quantification  
 All values reported on a per vial basis unless otherwise noted  
 Copyright © 2026 Krause Analytical LLC. All rights reserved.


Respectfully submitted,

Mark C. Krause  
 Laboratory Director

\*\*\*\*\*  
CHROMATOGRAM  
\*\*\*\*\*

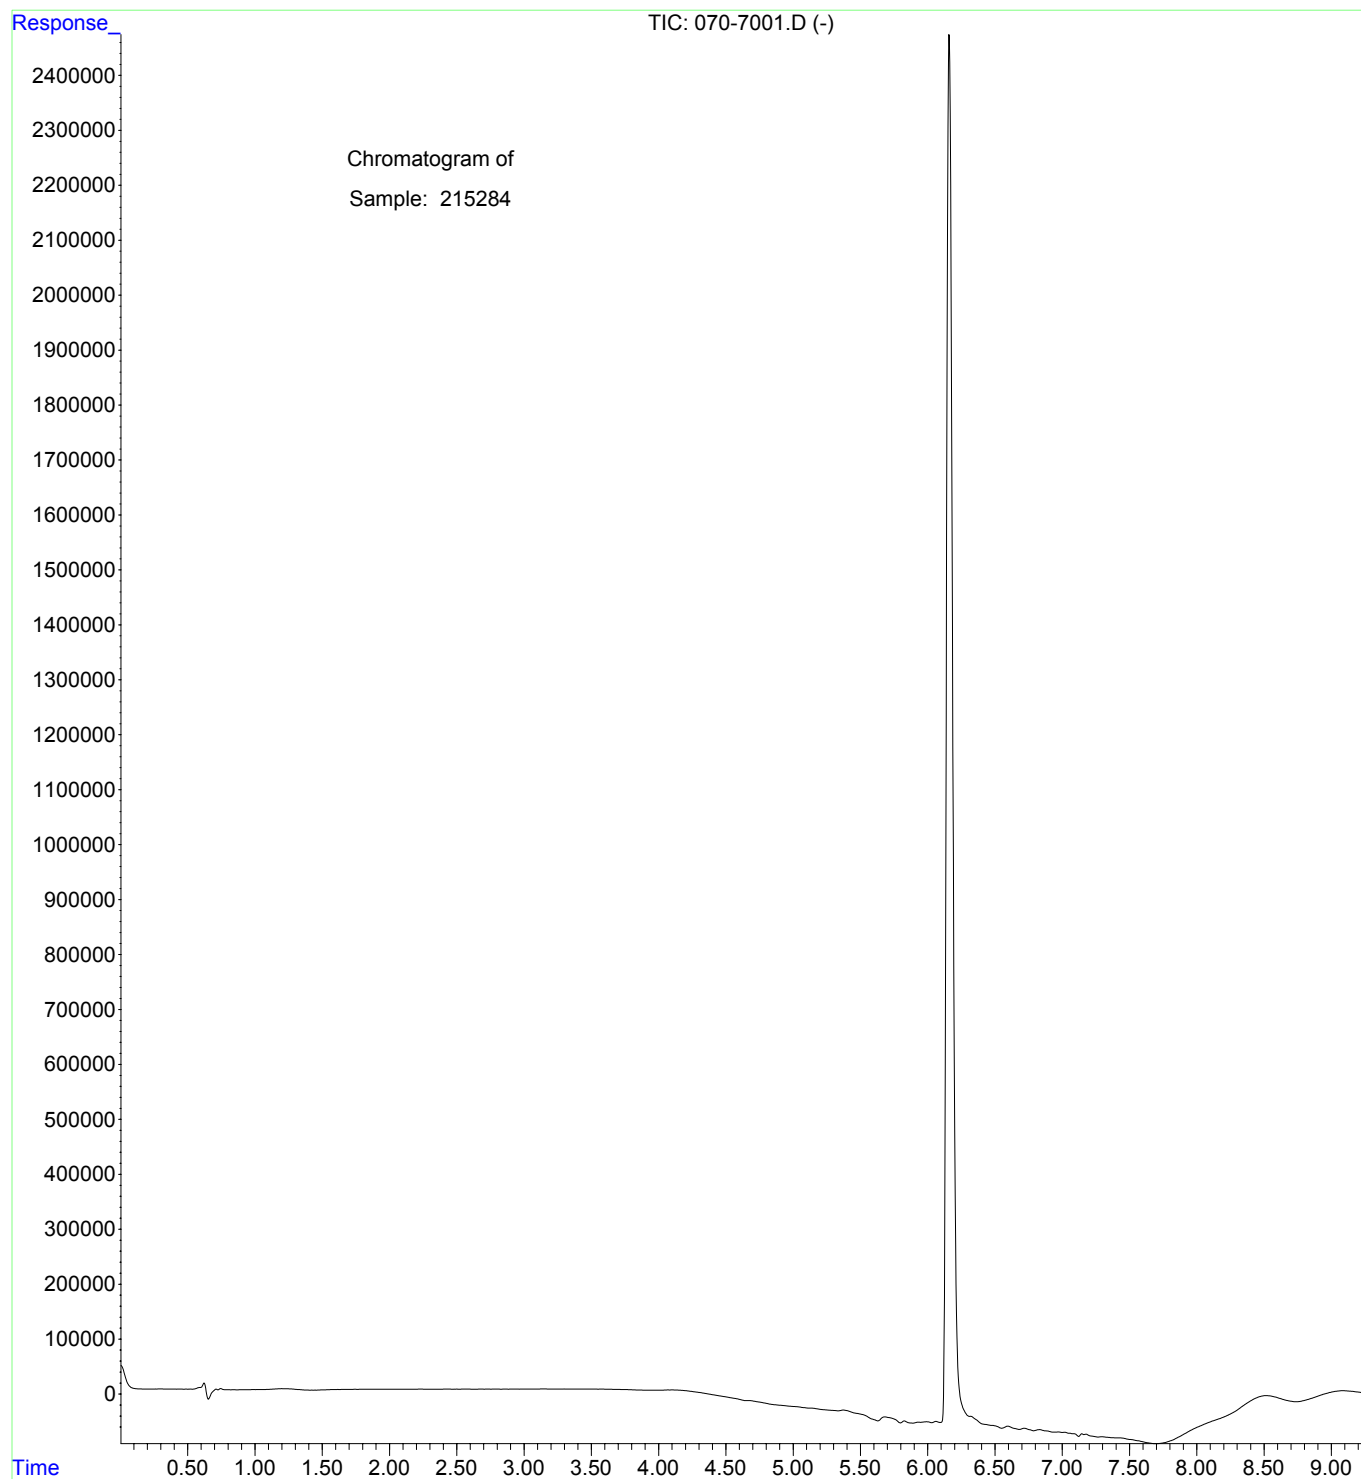

215284 336 (6.210)

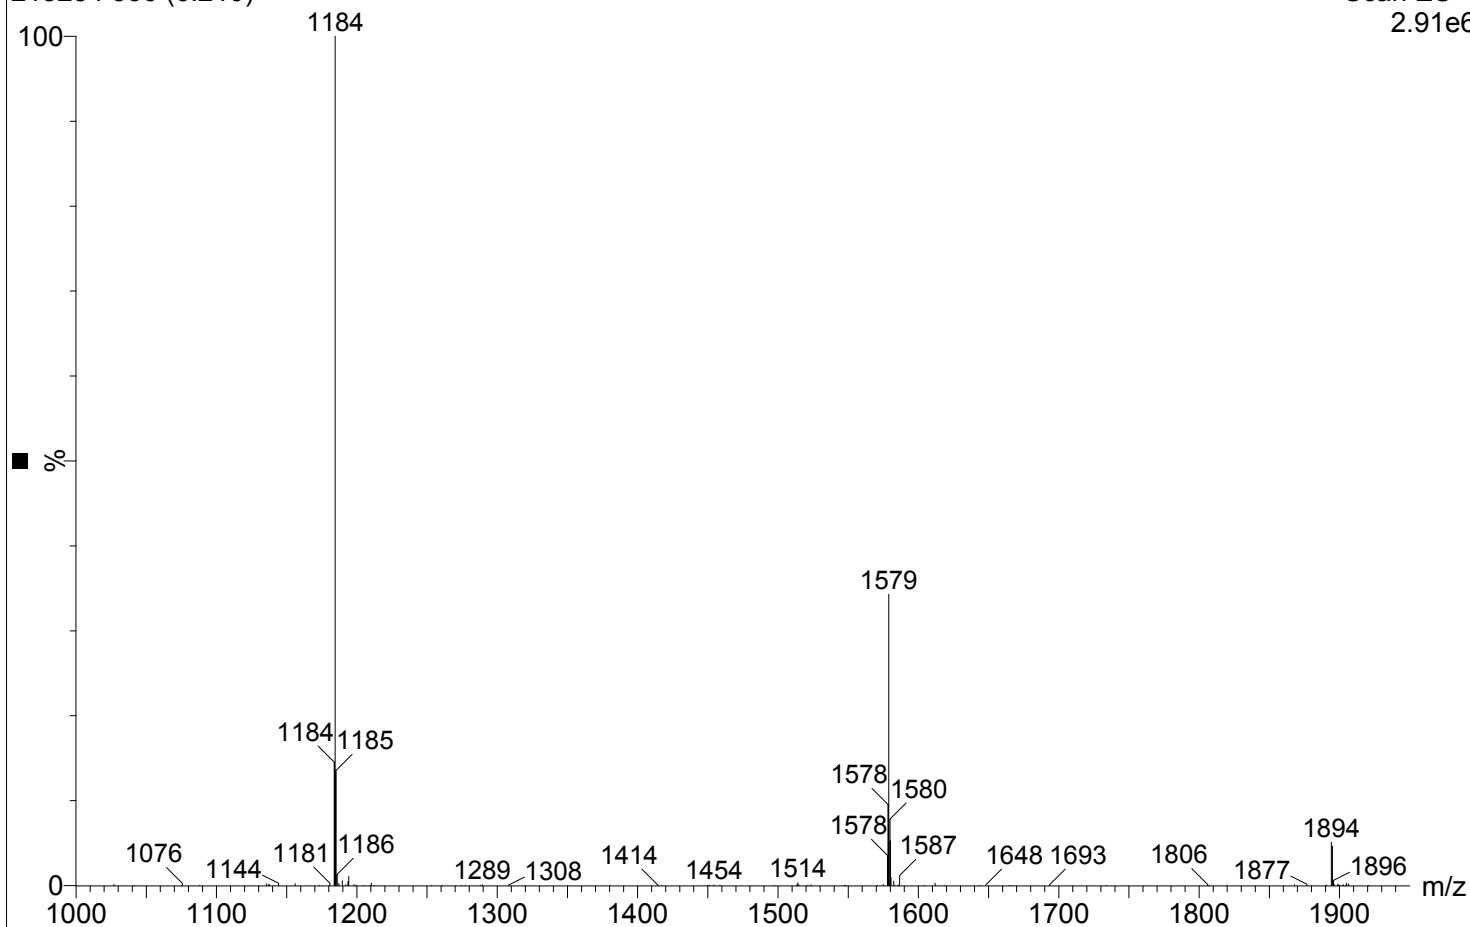Scan ES+  
2.91e6

Retatrutide 335 (6.192)

Scan ES+  
2.91e6