

Marsden Research Labs
 1-844-8-MRLABS
 info@mrlabs.us
 465 Nevada Way Suite 3
 Boulder City, NV 89005



Project 145982
Lab # 215285
Date Rec'd 10/5/2026
Report Issued 10/27/2026

Certificate of Analysis



Compound DSIP
Label Claim 10 mg
Batch/Lot MRL-DS10


<u>Analyte</u>	<u>Result</u>	<u>Units</u>	<u>LOQ</u>	<u>% of Label</u>	<u>Method</u>	<u>Date</u>	<u>CAS</u>
Peptides & Bioactives							
Chromatographic purity	>99.9	%	1		HPLC-UV/MS	10/13/2026	
DSIP	8.76	mg	.1	87.6	HPLC-UV-MS	10/13/2026	62568-57-4
Mass Spectral Match	ID Confirmed				HPLC-UV-MS	10/13/2026	

The data presented are from the analysis of the sample shown and meet Krause Analytical internal quality assurance criteria unless otherwise flagged.
 Methods shown reference current Krause Analytical SOPs
 ND - Not detected LOQ - limit of quantification
 All values reported on a per vial basis unless otherwise noted
 Copyright © 2026 Krause Analytical LLC. All rights reserved.


Respectfully submitted,

Mark C. Krause
 Laboratory Director

CHROMATOGRAM

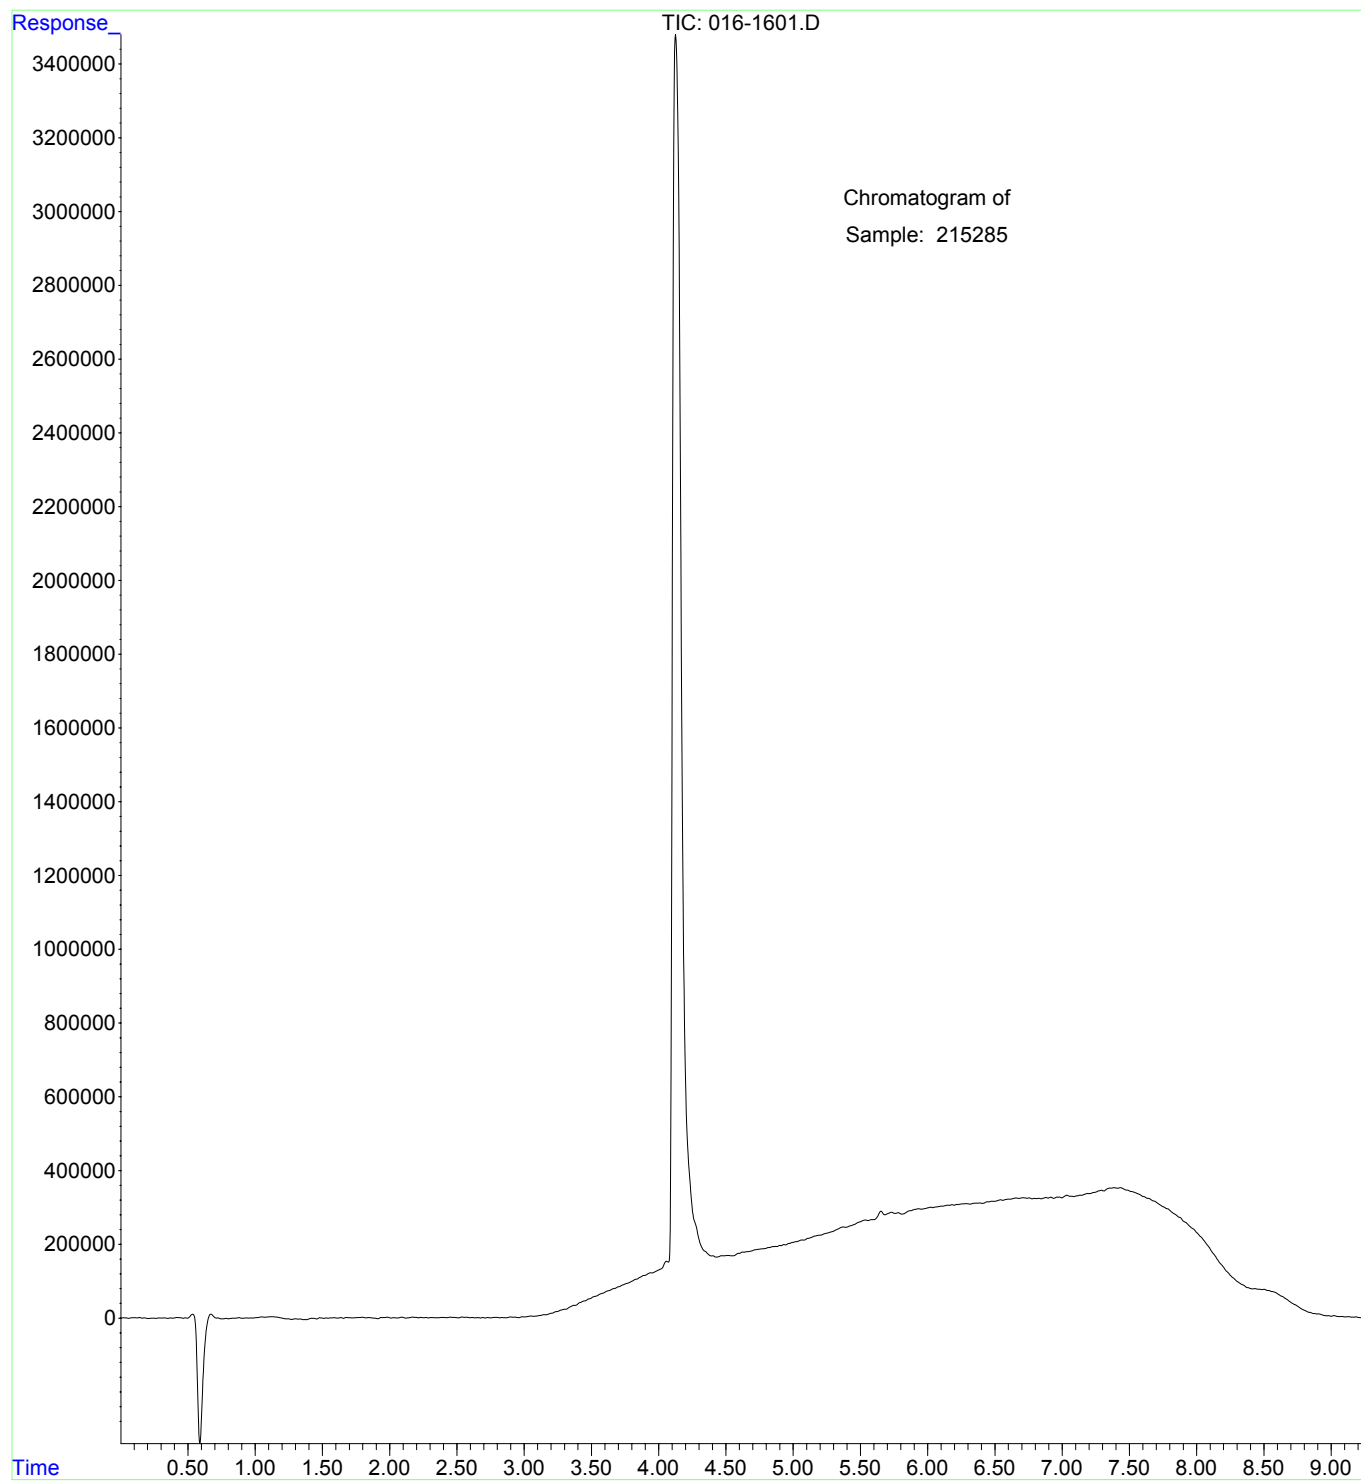

215285 20 (0.370) Cm (17:34)

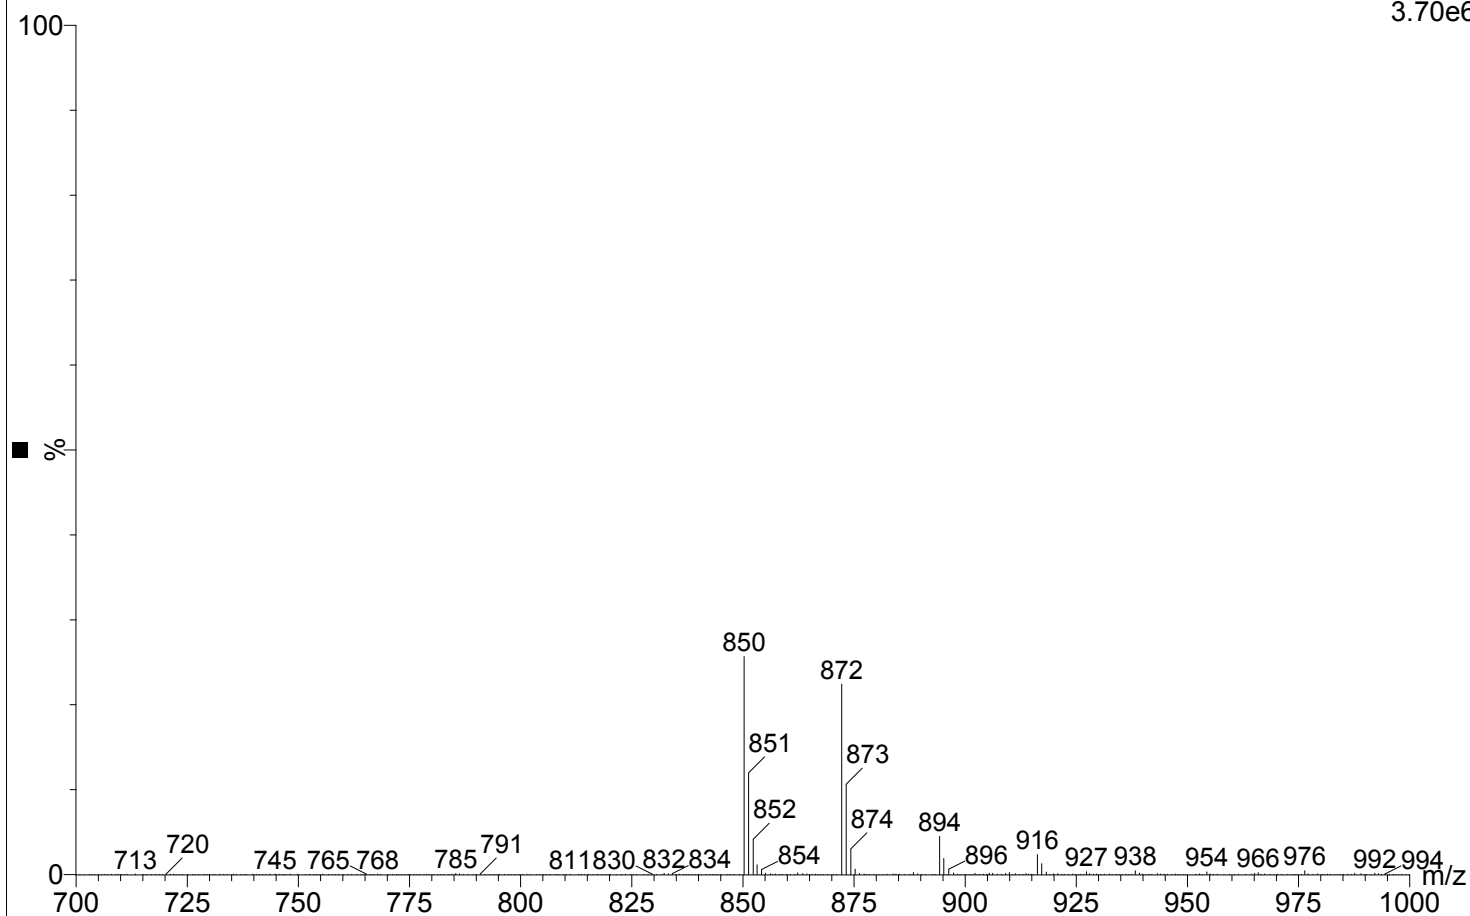Scan ES+
3.70e6

DSIP 22 (0.407) Cm (19:33)

Scan ES+
3.70e6